

FLOWTITE PRODUCTS


RAINWATER HARVESTING

NOTE: CUSTOMER SUPPLIED "ASTM C-1644" APPROVED FLEXIBLE PIPING COUPLING REQUIRED ON TANGENTIALLY MTD. NOZZLES, & PIPES

SHELL CODES: 2-EXS10SD



THIS IS AN IAPMO APPROVED TANK COMPLIANCE STANDARDS AND CODES: IAPMO/ANSI Z1002 UNIFORM PLUMBING CODE (UPC) MFG. PER PE-C22.85

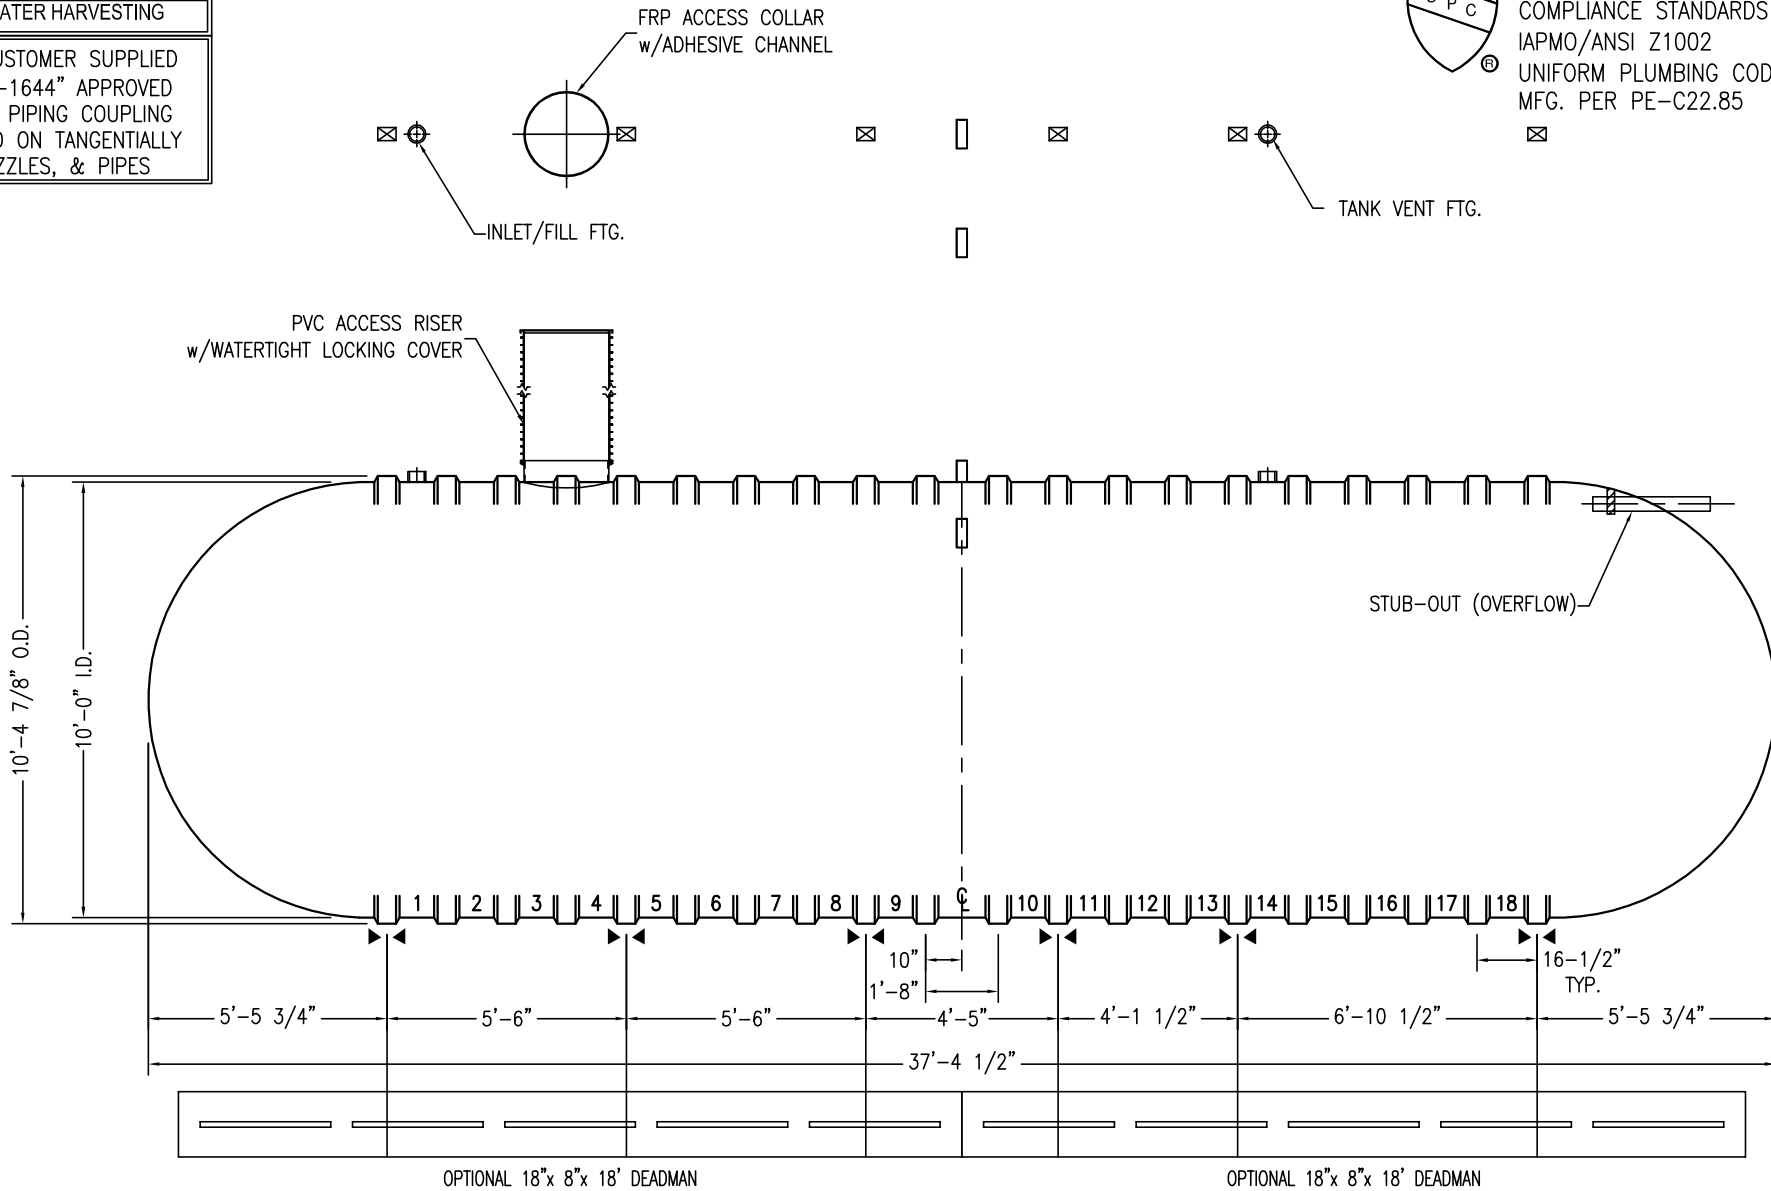

OPTIONAL 18" x 8" x 18' DEADMAN

OPTIONAL 18" x 8" x 18' DEADMAN

THIS DIAGRAM IS THE PROPERTY OF CONTAINMENT SOLUTIONS, INC., AND IS FOR ILLUSTRATION PURPOSES ONLY. IT IS NOT TO BE RELIED UPON FOR ANY OTHER PURPOSE. NO WARRANTY OF MERCHANTABILITY OF FITNESS FOR A PARTICULAR PURPOSE OR OF ANY OTHER KIND, EXPRESSED OR IMPLIED IS HEREBY MADE. COPYRIGHT © 2016 CONTAINMENT SOLUTIONS, INC. ALL RIGHTS RESERVED.

- IAPMO Z1002 MINIMUM REQUIRED TANK OPENINGS
- 1-ACCESS COLLAR OPENING (24", 30" or 36")
 - 1-ACCESS RISER w/WATERTIGHT LOCKING COVER
 - 1-INLET/FILL FITTING (4" MIN)
 - 1-TANK OVERFLOW (EQUAL TO THE INLET)
 - 1-TANK VENT (EQUAL TO LARGER-INLET OR OVERFLOW)

SWT D-6 (10')-20000		DATE: 7/28/2016
IAPMO RAINWATER HARVESTING		DRAWN BY: R.OXNER
CONTAINMENT SOLUTIONS	CAPACITY: 19,951	REVISED: 4/16/17-A
	WEIGHT: DRY/WET 6100	DWG NUMBER: 10-20 IRWH