

FLOWTITE PRODUCTS

SEPTIC / WASTE WATER


NOTE: CUSTOMER SUPPLIED
"ASTM C-1644" APPROVED
FLEXIBLE PIPING COUPLING
REQUIRED ON TANGENTIALLY
MTD. NOZZLES, & PIPES

SHELL CODES: 2-E8S11SD



THIS IS AN IAPMO APPROVED TANK
THE ONLY CHANGE ALLOWED TO
THIS TANK IS TO INCREASE THE
INLET AND OUTLET PIPE DIAMETER.
MFG. PER. PE-C22.85

CAPACITIES:
LIQUID VOLUME BELOW OUTLET = 10,492 GALS
AIR VOLUME ABOVE OUTLET = 1103 GALS

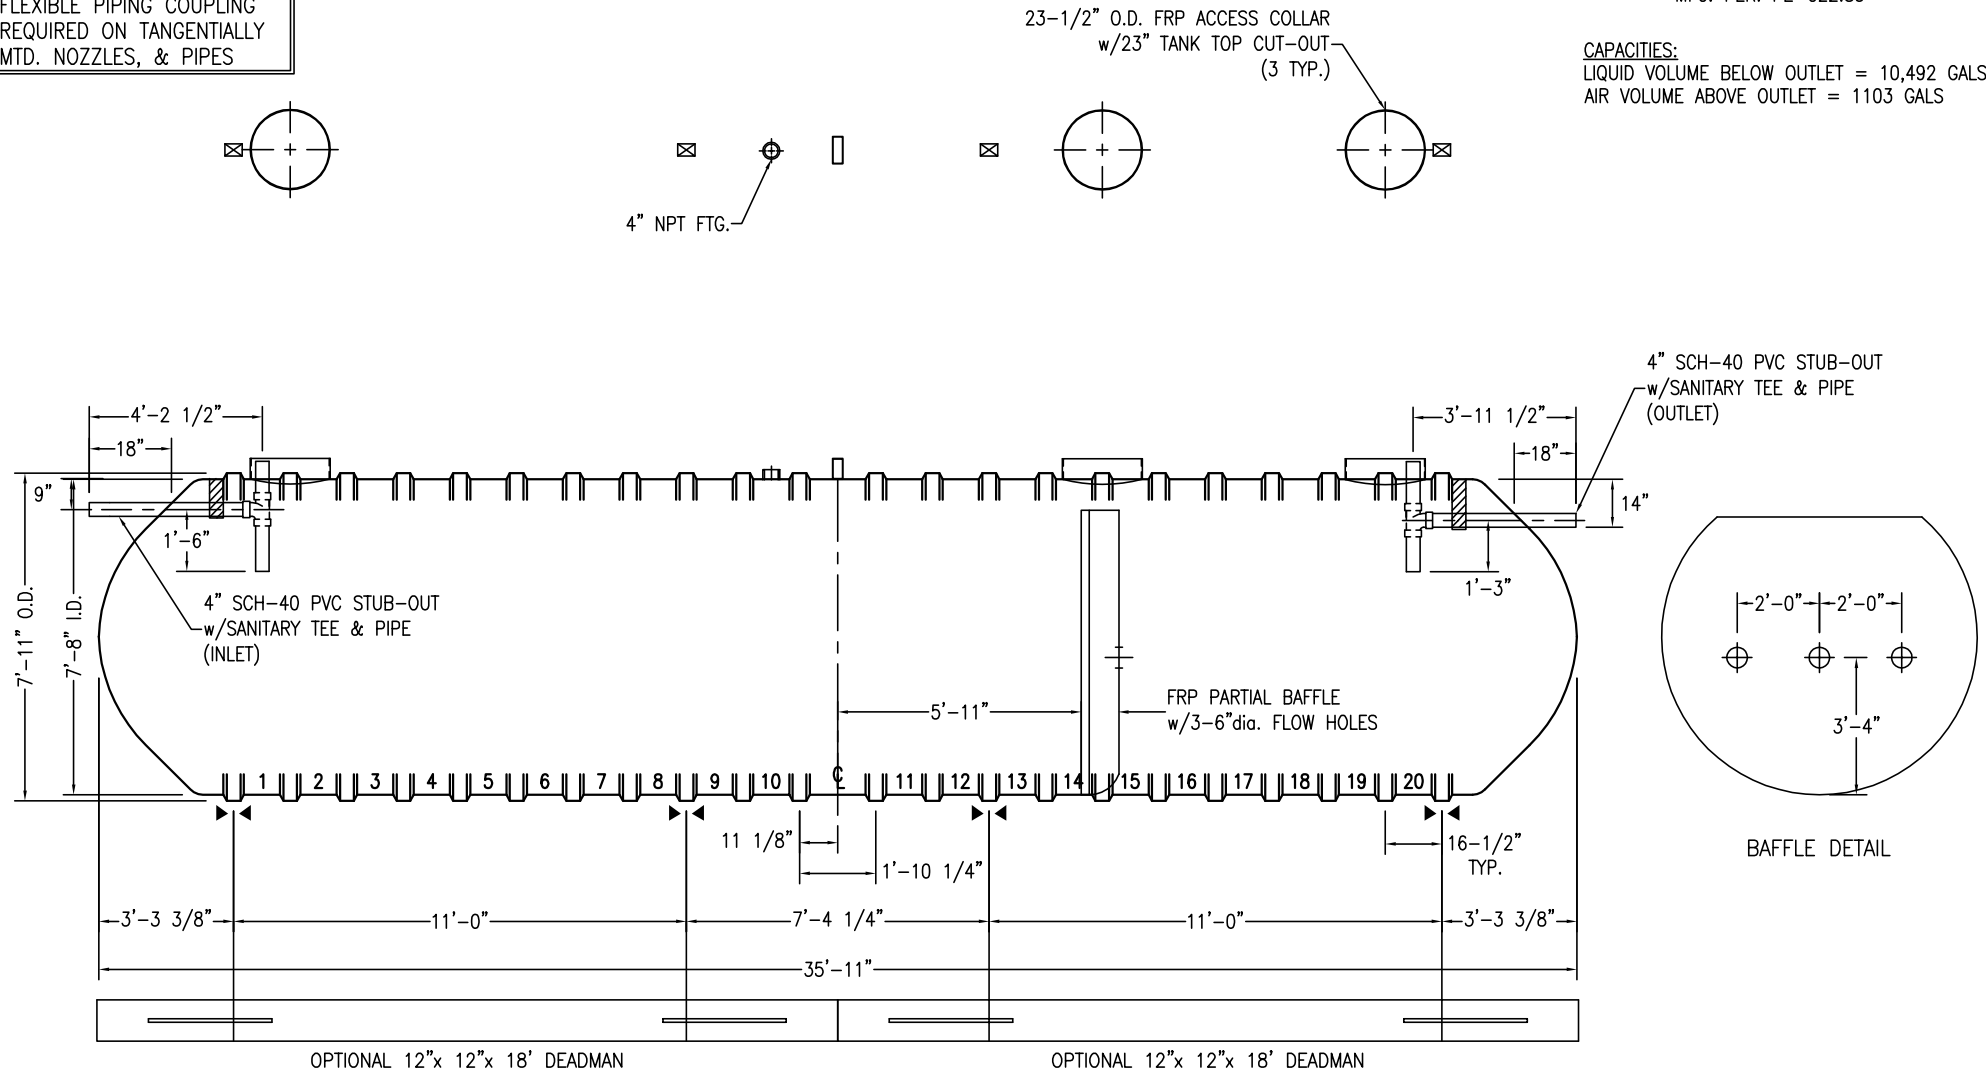

NOTES:

- ☒ HOLD DOWN STRAP CLIP
- ▶◀ HOLD DOWN STRAP LOCATION
- TYPE "13" LIFT LUG - SD
- TYPE "13" LIFT LUG - HD

SWT G-6 (8')-12000		DATE: 1/1/2014
		DRAWN BY: J.HARMON
CONTAINMENT SOLUTIONS	CAPACITY: 11,595	REVISED:
	WEIGHT: DRY/WET 3350	DWG NUMBER: 812MSW-IS